

Moonlite™ LED



Emergency & Security

1 Fc Average: 0.1 Fc Minimum

SPACING GUIDE

Tested in Accordance with IES Standard LM-79-08 for Solid State Lighting Products



Down Light- Series MLD, MLS, & MRD

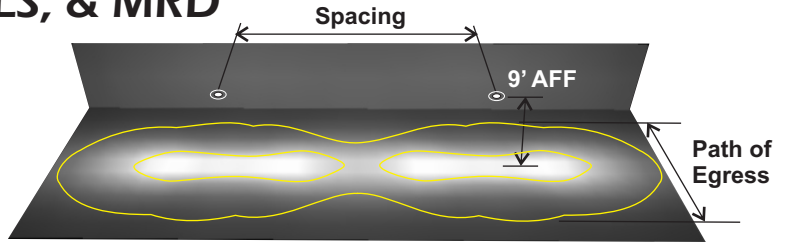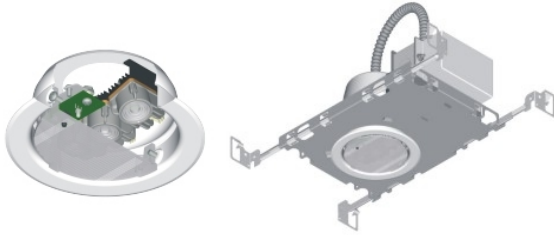

Model	Mtg. Ht.	SPACING		
		Path of Egress Width		
		3 Ft.	6 Ft.	10 Ft.
7W	9'	50'	40'	25'
10W	9'	55'	50'	40'

Illuminance Values- 6 Ft. Path of Egress				
	Average	Minimum	Max./Min. Ratio	Avg./Min. Ratio
7W	1.03	0.39	7.21	2.64
10W	1.21	0.16	26.13	7.56



Interior Wall Mount- Series MLW

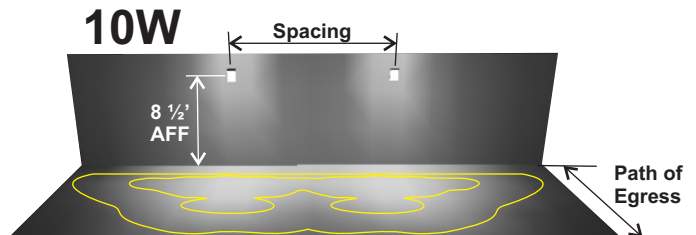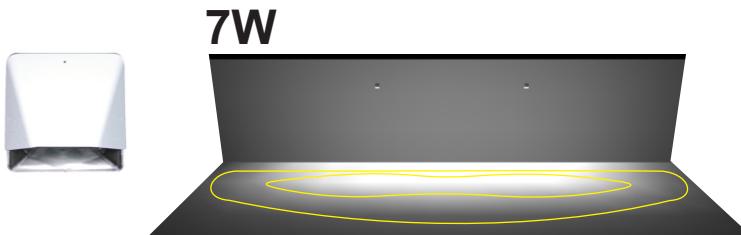

Model	Mtg. Ht.	SPACING		
		Path of Egress Width		
		3 Ft.	6 Ft.	10 Ft.
7W	8 1/2'	40'	35'	25'
10W	8 1/2'	45'	40'	35'

Illuminance Values- 6 Ft. Path of Egress				
	Average	Minimum	Max./Min. Ratio	Avg./Min. Ratio
7W	1.02	0.16	19.31	6.38
10W	1.19	0.15	28.60	7.93

Exterior Wall Mount- Series MOE

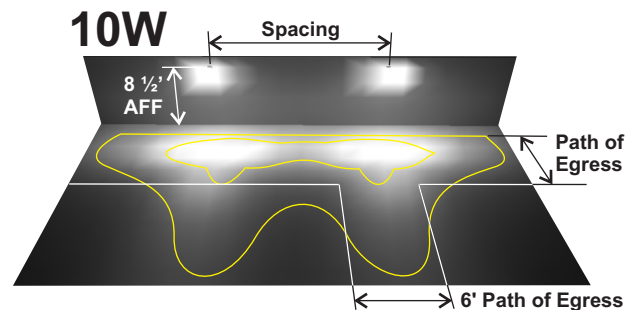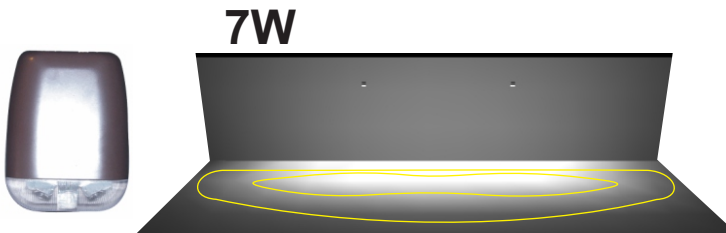

Model	Mtg. Ht.	SPACING		
		Path of Egress Width		
		3 Ft.	6 Ft.	10 Ft.
7W	8 1/2'	40'	30'	20'
10W	8 1/2'	40'	35'	30'

Illuminance Values- 6 Ft. Path of Egress				
	Average	Minimum	Max./Min. Ratio	Avg./Min. Ratio
7W	1.09	0.36	8.17	3.03
10W	1.16	0.16	23.69	7.25

*10W Projection from Building: 30 Ft

CONTACT SIGNTEX FOR LAYOUT ASSISTANCE

Code Compliant Emergency lighting layouts provided free of charge!

NOTE: FOR REFERENCE ONLY. STANDARD REFLECTANCES 80/50/20. SIGNTEX IS NOT RESPONSIBLE FOR SPECIFIC CONDITIONS THAT MAY ALTER THE RESULTS. COMPLETE IES PHOTOMETRIC DATA AVAILABLE AT WWW.SIGNTEXINC.COM FOR YOUR CONVENIENCE.



Signtex Inc
LIGHTING

220 VFW Avenue, Grasonville, MD 21638
TEL: (410) 827-8300 Fax: (410) 827-8866
sales@signtexinc.com www.signtexinc.com



Moonlite™ LED

Emergency & Security

2 Fc Average: 1 Fc Minimum SPACING GUIDE

Tested in Accordance with IES Standard LM-79-08 for Solid State Lighting Products

Down Light- Series MLD, MLS, & MRD

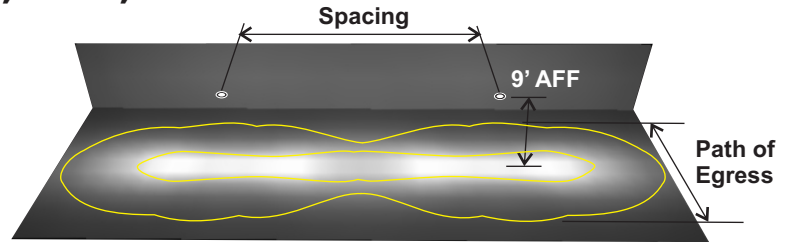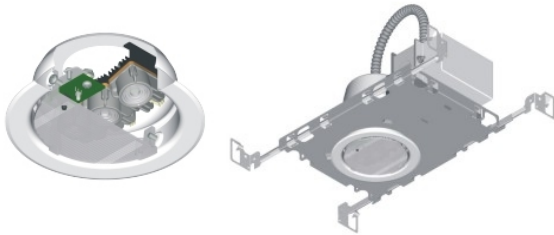


10 W

Illuminance Values- 3 Ft. Path of Egress				
	Average	Minimum	Max./Min. Ratio	Avg./Min. Ratio
10W	3.18	1.73	2.49	1.84

Model	Mtg. Ht.	Path of Egress Width	
		3 Ft.	6 Ft.
10W	9'	30'	30'

Interior Wall Mount- Series MLW

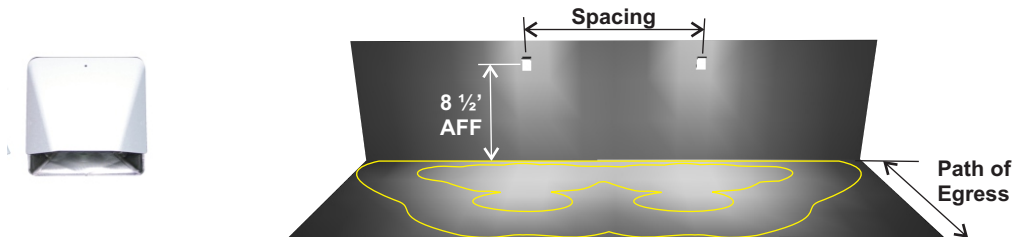


10W

Illuminance Values- 3 Ft. Path of Egress				
	Average	Minimum	Max./Min. Ratio	Avg./Min. Ratio
10W	1.83	1.27	1.76	1.44

Model	Mtg. Ht.	Path of Egress Width	
		3 Ft.	6 Ft.
10W	8 1/2'	25'	20'

Exterior Wall Mount- Series MOE

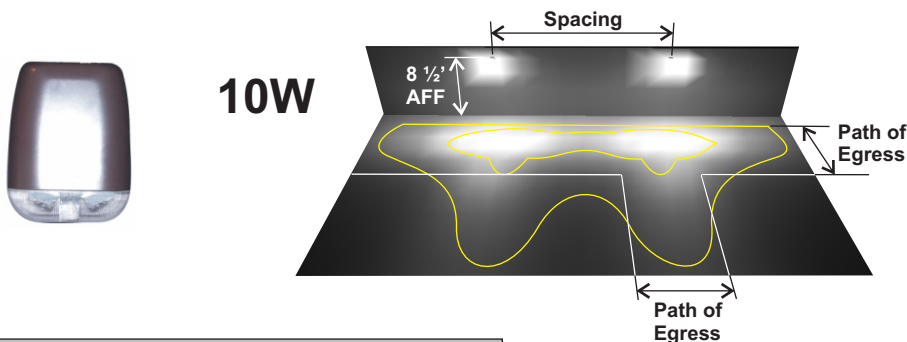

10W

Illuminance Values- 6 Ft. Path of Egress				
	Average	Minimum	Max./Min. Ratio	Avg./Min. Ratio
10W	2.58	1.62	2.27	1.59

Model	Mtg. Ht.	Path of Egress Width	
		3 Ft.	6 Ft.
10W	8 1/2'	20'	15'

CONTACT SIGNTEX FOR LAYOUT ASSISTANCE

Code Compliant Emergency lighting layouts provided free of charge!

NOTE: FOR REFERENCE ONLY. STANDARD REFLECTANCES 80/50/20. SIGNTEX IS NOT RESPONSIBLE FOR SPECIFIC CONDITIONS THAT MAY ALTER THE RESULTS. COMPLETE IES PHOTOMETRIC DATA AVAILABLE AT WWW.SIGNTEXINC.COM FOR YOUR CONVENIENCE.



Signtex Inc
LIGHTING

220 VFW Avenue, Grasonville, MD 21638
TEL: (410) 827-8300 Fax: (410) 827-8866
sales@signtexinc.com www.signtexinc.com